



Current DEER Demand Savings Definition



Bryan Pena and Jeff Hirsch
California Public Utilities Commission

4/3/2018





DEER Demand Savings Definition Overview

- The DEER electric demand reduction (savings) attributable to any energy efficiency activity measure or project is based on the average kWh reduction of the grid system load at the site boundary (meter or meters) during the defined peak period.
- The DEER defined dates are relative to the CEC adopted climate data files used for Title 24 analysis. Measured or calculated demand reduction values for specific locations and years would be relative to the peak period for that specific weather and must be referenced back to the typical weather before being used for claims reporting.





DEER Demand Savings Definition History of Adoption for EE

First adopted by CPUC for use in EE by D.06-06-063 OP 1

- Prior to that adoption varying definition were used
- 2006 Workshops explored several related issues
 - Alternative demand savings definitions were presented and discussed ranging from summertime TOU rate period averages to three day DEER grid peak period
 - Issues related to IOU “TOU” (5 to 6 period averages) impact bins versus “Hourly” (8760) impact profiles applied to avoided cost hourly (8760) values

DEER2013 Update due to CEC adopting new typical weather

- Typical months from 1997-2008 with same month for all locations for better synchronization of grid impacts





DEER Demand Savings Definition

Elements of Definition

Step 1

Select days when grid peak is likely to occur:

- for the period June 1st and September 30th
- excluding weekends or holidays
- three consecutive days with the highest three value sum of
 - average temperature over the three-day period +
 - the average temperature from noon to 6 p.m. over the three-day period +
 - the peak temperature over the three-day period

Typical weather (i.e., CEC CTZ's) versus specific years of local weather can result in different days





DEER Demand Savings Definition

Elements of Definition – Weather File Change in 2013

| Climate Zone | CZ2 (2008 Title-24) Weather Files | | | | | CZ2010 (2013 Title-24) Weather Files | | | | |
|--------------|-----------------------------------|---------|--------|-------|--|--------------------------------------|---------|--------|-------|--|
| | Start Date | Weekday | Peak T | Ave T | | Start Date | Weekday | Peak T | Ave T | |
| CZ01 | Sep 30 | Mon | 80 | 58.0 | | Sep 16 | Wed | 81 | 59.8 | |
| CZ02 | Jul 22 | Mon | 99 | 77.9 | | Jul 8 | Wed | 103 | 75.9 | |
| CZ03 | Jul 17 | Wed | 89 | 65.4 | | Jul 8 | Wed | 91 | 69.2 | |
| CZ04 | Jul 17 | Wed | 97 | 70.8 | | Sep 1 | Tue | 99 | 77.5 | |
| CZ05 | Sep 3 | Tue | 93 | 67.6 | | Sep 8 | Tue | 87 | 64.8 | |
| CZ06 | Jul 9 | Tue | 85 | 69.0 | | Sep 1 | Tue | 102 | 77.1 | |
| CZ07 | Sep 9 | Mon | 92 | 70.1 | | Sep 1 | Tue | 90 | 73.9 | |
| CZ08 | Sep 23 | Mon | 98 | 78.2 | | Sep 1 | Tue | 105 | 79.8 | |
| CZ09 | Aug 6 | Tue | 101 | 78.3 | | Sep 1 | Tue | 107 | 86.6 | |
| CZ10 | Jul 8 | Mon | 104 | 83.5 | | Sep 1 | Tue | 109 | 86.3 | |
| CZ11 | Jul 31 | Wed | 104 | 80.7 | | Jul 8 | Wed | 113 | 88.3 | |
| CZ12 | Aug 5 | Mon | 103 | 81.0 | | Jul 8 | Wed | 109 | 82.4 | |
| CZ13 | Aug 14 | Wed | 106 | 87.1 | | Jul 8 | Wed | 108 | 86.7 | |
| CZ14 | Jul 9 | Tue | 106 | 89.7 | | Aug 26 | Wed | 105 | 86.8 | |
| CZ15 | Jul 30 | Tue | 114 | 96.2 | | Aug 25 | Tue | 112 | 97.5 | |
| CZ16 | Aug 6 | Tue | 96 | 73.1 | | Jul 8 | Wed | 90 | 78.8 | |





DEER Demand Savings Definition

Elements of Definition – Historical Actual Grid Peak

| Year | Megawatts at Peak Load* | Date | Time |
|------|-------------------------|--------------|-------|
| 1998 | 44,659 | August 12 | 14:30 |
| 1999 | 45,884 | July 12 | 16:52 |
| 2000 | 43,784 | August 16 | 15:17 |
| 2001 | 41,419 | August 7 | 16:17 |
| 2002 | 42,441 | July 10 | 15:01 |
| 2003 | 42,689 | July 17 | 15:22 |
| 2004 | 45,597 | September 8 | 16:00 |
| 2005 | 45,431 | July 20 | 15:22 |
| 2006 | 50,270 | July 24 | 14:44 |
| 2007 | 48,615 | August 31 | 15:27 |
| 2008 | 46,897 | June 20 | 16:21 |
| 2009 | 46,042 | September 3 | 16:17 |
| 2010 | 47,350 | August 25 | 16:20 |
| 2011 | 45,545 | September 7 | 16:30 |
| 2012 | 46,846 | August 13 | 15:53 |
| 2013 | 45,097 | June 28 | 16:54 |
| 2014 | 45,089 | September 15 | 16:53 |
| 2015 | 46,519 | September 10 | 15:38 |
| 2016 | 46,232 | July 27 | 16:51 |
| 2017 | 50,116 | September 1 | 15:58 |



California ISO

California ISO Peak Load History 1998 through 2017

Note: The DEER method for selecting the days of likely grid peak has proven accurate over the last 17 years of actual weather and actual recorded peak occurrence. However, the DEER CTZ table is for the CEC adopted typical weather.





DEER Demand Savings Definition

Elements of Definition

Step 2

Calculate the demand reduction for the measure or project:

- calculate the hourly energy use for the base case (pre-existing or standard case) and the installed measure case
- average that hourly savings value for the 2pm – 5pm (three hours) peak period during the three day grid peak period identified in step 1






DEER Demand Savings Definition

Alternative Peak Periods – 2017 Example

| Dates | PGE | SCE | SDGE | CAISO Total | % of Peak |
|------------------------|---------------|---------------|--------------|---------------|-------------|
| 8/30/17 2:00 PM | 15,427 | 22,254 | 3,768 | 41,544 | 83% |
| 8/30/17 3:00 PM | 16,167 | 23,118 | 3,964 | 43,345 | 87% |
| 8/30/17 4:00 PM | 16,944 | 23,759 | 4,188 | 44,992 | 90% |
| 8/30/17 5:00 PM | 17,640 | 23,997 | 4,321 | 46,062 | 92% |
| 8/30/17 6:00 PM | 18,037 | 23,770 | 4,328 | 46,235 | 93% |
| 8/30/17 7:00 PM | 18,031 | 23,030 | 4,175 | 45,329 | 91% |
| 8/30/17 8:00 PM | 17,510 | 22,512 | 4,086 | 44,199 | 89% |
| 8/30/17 9:00 PM | 16,984 | 21,915 | 3,935 | 42,921 | 86% |
| 8/31/17 2:00 PM | 15,893 | 23,037 | 3,971 | 43,003 | 86% |
| 8/31/17 3:00 PM | 16,911 | 23,687 | 4,069 | 44,770 | 90% |
| 8/31/17 4:00 PM | 17,969 | 23,771 | 4,133 | 45,979 | 92% |
| 8/31/17 5:00 PM | 18,981 | 23,270 | 4,127 | 46,485 | 93% |
| 8/31/17 6:00 PM | 19,535 | 22,503 | 4,190 | 46,334 | 93% |
| 8/31/17 7:00 PM | 19,565 | 21,858 | 4,085 | 45,607 | 91% |
| 8/31/17 8:00 PM | 19,194 | 21,709 | 4,035 | 45,030 | 90% |
| 8/31/17 9:00 PM | 18,601 | 21,261 | 3,925 | 43,874 | 88% |
| 9/1/17 2:00 PM | 18,876 | 22,962 | 4,235 | 46,177 | 93% |
| 9/1/17 3:00 PM | 19,902 | 23,775 | 4,360 | 48,146 | 96% |
| 9/1/17 4:00 PM | 20,852 | 24,186 | 4,477 | 49,627 | 99% |
| 9/1/17 5:00 PM | 21,517 | 23,792 | 4,476 | 49,900 | 100% |
| 9/1/17 6:00 PM | 21,714 | 23,419 | 4,405 | 49,649 | 99% |
| 9/1/17 7:00 PM | 21,333 | 22,580 | 4,236 | 48,256 | 97% |
| 9/1/17 8:00 PM | 20,672 | 22,050 | 4,161 | 46,980 | 94% |
| 9/1/17 9:00 PM | 20,006 | 21,556 | 4,065 | 45,717 | 92% |
| Average | 18,678 | 22,907 | 4,155 | 45,840 | 92% |

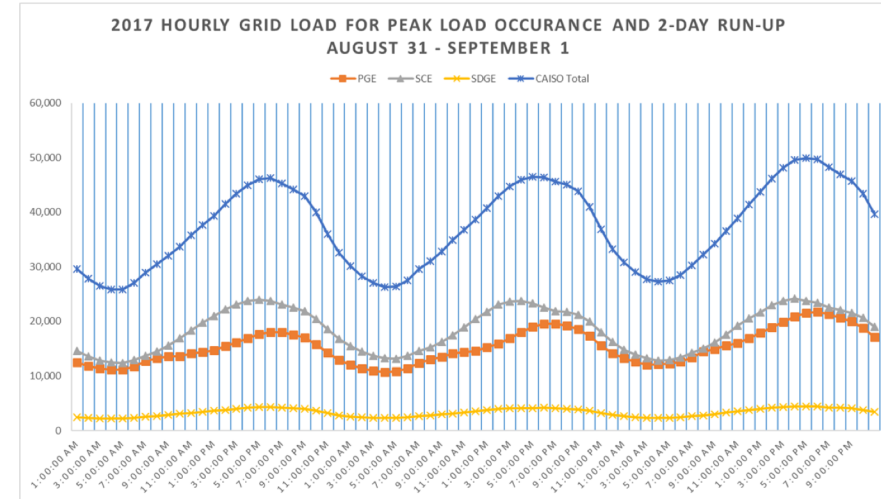

| | |
|-----------------------|--------|
| All Year All Hours | 26,385 |
| All Year 4-9PM | 30,356 |
| June 1-Sept 30 4-9PM | 36,300 |
| Aug 30 - Sept 1 4-9pm | 46,172 |
| Aug 30 - Sept 1 3-6pm | 47,252 |
| Aug 30 - Sept 1 2-5pm | 46,590 |





DEER Demand Savings Definition

Hourly versus “TOU” impact profiles


- Measure or project electric benefits for cost effectiveness tests (TRC and PAC) are calculated by multiplying the avoided cost values by the savings profile. Profiles types:
 - IOU “TOU” profiles provide the consumption and demand averaged during the 5-6 TOU older rate periods
 - Hourly profiles provide an 8750 hour profile of electric consumption





DEER Demand Savings Definition

Hourly versus "TOU" impact profiles

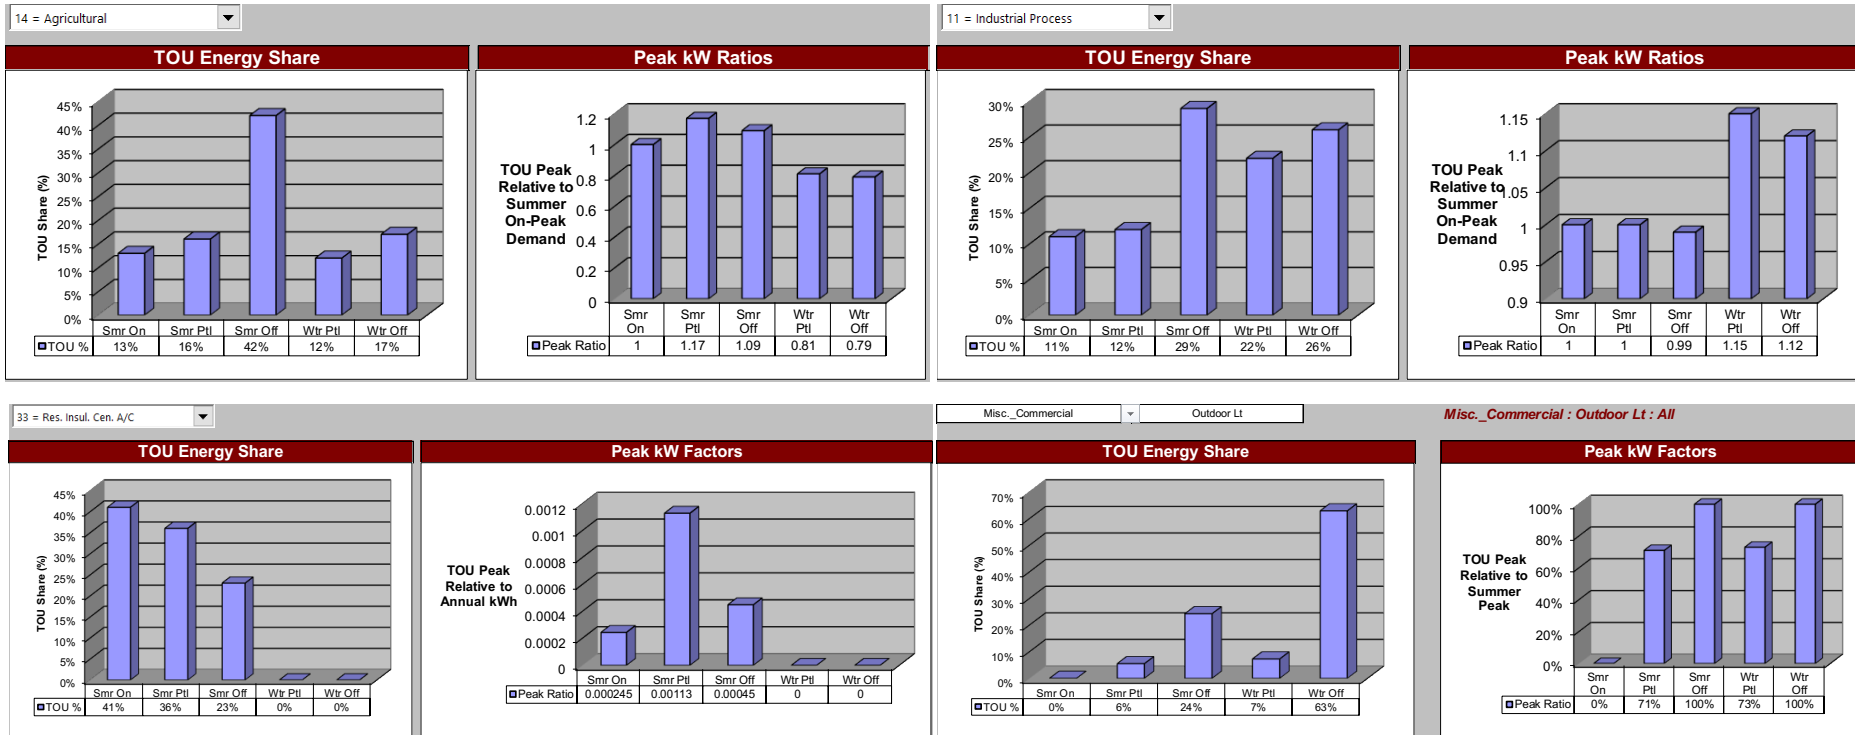



DEER Demand Savings Definition

Hourly versus “TOU” impact profiles

Use of DEER hourly impact profiles versus IOU TOU period profiles in 2017 claims (Electric claims excluding Codes and Standards programs)

All Claims

| | IOU | Yr 1 Net kW | Yr 1 Net kWh | Life Net kW | Life Net kWh | Incentives |
|--------------------|-----|--------------|--------------|--------------|--------------|--------------|
| PGE | | 32.2% | 59.3% | 41.0% | 42.5% | 60.3% |
| SCE | | 89.0% | 77.0% | 89.4% | 74.7% | 81.8% |
| SDGE | | 71.0% | 80.9% | 70.8% | 94.9% | 89.7% |
| Grand Total | | 57.1% | 70.0% | 61.7% | 66.5% | 74.8% |

Residential Claims

| | | | | | | |
|--------------------|--|--------------|--------------|--------------|--------------|--------------|
| PGE | | 17.3% | 73.0% | 17.2% | 43.2% | 82.8% |
| SCE | | 95.4% | 93.6% | 96.2% | 92.6% | 91.6% |
| SDGE | | 66.4% | 79.6% | 66.4% | 95.6% | 90.2% |
| Grand Total | | 49.0% | 81.7% | 49.1% | 80.4% | 88.5% |

Non-Residential Claims

| | | | | | | |
|--------------------|--|--------------|--------------|--------------|--------------|--------------|
| PGE | | 60.4% | 46.6% | 87.0% | 42.1% | 49.1% |
| SCE | | 81.7% | 58.1% | 81.7% | 56.2% | 72.3% |
| SDGE | | 95.4% | 89.7% | 95.2% | 89.4% | 87.1% |
| Grand Total | | 72.1% | 53.9% | 85.4% | 50.2% | 60.7% |





DEER Demand Savings Definition

Alternative Peak Day and Hour Periods

Using DEER Hourly Profiles for HVAC Measure

| | Single Family Home | Large Office | |
|--------------------------------------|--------------------|--------------|------|
| | CZ10 | CZ03 | CZ06 |
| Current DEER | 100% | 100% | 100% |
| Current DEER Shifted to 3-6PM | 105% | 91% | 94% |
| Current DEER Shifted to 4-9PM | 81% | 42% | 54% |
| 4-9 PM June-Sept Weekdays | 38% | 46% | 60% |
| 4-9 PM June-Sept All Days | 37% | 40% | 53% |
| 4-9 PM All Year Weekdays | 15% | 34% | 44% |
| 4-9 PM All Year All Days | 15% | 29% | 38% |





DEER Demand Savings Definition

Alternative Peak Periods – DEER Residential

| Location | Lighting Measure | | SEER 17 Measure | |
|----------|------------------|----------|-----------------|----------|
| | 3p to 6p | 4p to 9p | 3p to 6p | 4p to 9p |
| CZ01 | 7% | 67% | -48% | -90% |
| CZ02 | -3% | 23% | 16% | 14% |
| CZ03 | 3% | 30% | 15% | 10% |
| CZ04 | -1% | 30% | 8% | -3% |
| CZ05 | 5% | 42% | 13% | -19% |
| CZ06 | 2% | 38% | 7% | -7% |
| CZ07 | 4% | 47% | 3% | -10% |
| CZ08 | 5% | 59% | -2% | -15% |
| CZ09 | 3% | 63% | -1% | -26% |
| CZ10 | 3% | 61% | 2% | -18% |
| CZ11 | -2% | 33% | 9% | 1% |
| CZ12 | -5% | 25% | 14% | 15% |
| CZ13 | 0% | 40% | 11% | 16% |
| CZ14 | 3% | 53% | -1% | -15% |
| CZ15 | 4% | 53% | 2% | 3% |
| CZ16 | 5% | 38% | 3% | -5% |





DEER Demand Savings Definition

Alternative Peak Periods – DEER Non-Res Lighting

| Location | Small Office | | Large Office | | Small Retail | | 3-Story Large Retail | |
|----------|--------------|--------|--------------|--------|--------------|--------|----------------------|--------|
| | 3-6 pm | 4-9 pm | 3-6 pm | 4-9 pm | 3-6 pm | 4-9 pm | 3-6 pm | 4-9 pm |
| CZ01 | -6.3% | -46.2% | -8.9% | -45.1% | -3.0% | -24.8% | 1.1% | -8.6% |
| CZ02 | -5.3% | -48.8% | -9.6% | -47.1% | -3.1% | -24.8% | 0.4% | 0.5% |
| CZ03 | -9.1% | -50.2% | -13.9% | -49.4% | -9.3% | -42.3% | -0.8% | -19.6% |
| CZ04 | -6.9% | -50.7% | -15.0% | -22.0% | -7.7% | -37.1% | -0.3% | -18.0% |
| CZ05 | -6.0% | -52.5% | -11.4% | -49.4% | -4.5% | -30.7% | -0.9% | -7.1% |
| CZ06 | -6.3% | -51.5% | -11.3% | -49.4% | -4.5% | -27.4% | 0.2% | -4.6% |
| CZ07 | -3.9% | -48.1% | -9.4% | -48.0% | -3.6% | -23.0% | 0.1% | 1.4% |
| CZ08 | -3.7% | -49.0% | -9.6% | -25.3% | -3.1% | -23.5% | 0.5% | 1.7% |
| CZ09 | -7.9% | -53.4% | -11.1% | -49.6% | -4.8% | -27.6% | -0.1% | -5.0% |
| CZ10 | -5.3% | -49.8% | -8.8% | -31.6% | -3.4% | -24.0% | 0.1% | 1.2% |
| CZ11 | 0.7% | -46.1% | -12.2% | -16.5% | -8.0% | -36.3% | -0.6% | -17.7% |
| CZ12 | -5.3% | -48.8% | -8.2% | -31.8% | -3.4% | -23.7% | 0.6% | 2.0% |
| CZ13 | -6.0% | -51.8% | -12.9% | -50.3% | -7.2% | -36.3% | -0.4% | -17.8% |
| CZ14 | -6.0% | -52.5% | -10.9% | -37.2% | -5.8% | -27.2% | 0.5% | -3.8% |
| CZ15 | -5.7% | -50.9% | -11.1% | -29.2% | -4.0% | -26.9% | 0.0% | -4.8% |
| CZ16 | -4.0% | -51.5% | -11.1% | -49.9% | -4.1% | -27.2% | 0.1% | -4.5% |





DEER Demand Savings Definition

Alternative Peak Periods – DEER Non-Res HVAC

| CTZ | Small Office | | Large Office | | 3-Story Large Retail | |
|------|--------------|--------|--------------|--------|----------------------|--------|
| | 3-6 pm | 4-9 pm | 3-6 pm | 4-9 pm | 3-6 pm | 4-9 pm |
| CZ01 | 0.0% | -70.0% | -6.0% | -67.8% | -4.5% | -40.0% |
| CZ02 | -2.0% | -62.0% | -0.1% | -36.3% | 3.4% | -7.0% |
| CZ03 | 0.0% | -60.0% | 12.4% | -42.7% | -3.8% | -33.8% |
| CZ04 | 4.9% | -50.2% | -5.1% | -38.5% | -1.9% | -26.7% |
| CZ05 | -9.4% | -66.3% | -11.4% | -57.6% | -11.9% | -30.6% |
| CZ06 | -3.6% | -62.9% | -5.0% | -53.4% | 0.2% | -18.6% |
| CZ07 | -8.2% | -64.6% | -7.7% | -61.7% | -1.8% | -3.8% |
| CZ08 | -7.5% | -64.8% | -7.7% | -62.2% | -0.6% | -13.6% |
| CZ09 | -6.6% | -63.7% | -4.4% | -49.2% | -1.5% | -16.5% |
| CZ10 | -6.7% | -64.0% | -6.1% | -51.3% | -2.4% | -11.0% |
| CZ11 | -3.0% | -55.2% | 0.5% | -31.2% | -0.4% | -18.2% |
| CZ12 | 0.0% | -61.2% | -2.6% | -46.3% | 2.8% | 0.2% |
| CZ13 | 9.0% | -51.6% | 0.8% | -35.6% | 3.8% | -18.3% |
| CZ14 | -2.1% | -61.6% | 0.1% | -44.6% | 4.2% | -7.0% |
| CZ15 | -1.9% | -61.1% | -2.4% | -40.9% | 3.1% | -6.5% |
| CZ16 | -1.9% | -61.9% | -1.7% | -43.0% | 1.7% | -8.9% |

